

Sample Received: **June 11, 2026**

COA Issued: **June 15, 2026**

PRODUCT INFORMATION

| | | | | |
|------------------------------|-----------------------------------|---|------------------------------|-----------------------------|
| Vendor: Oasis Labs | Sample Name: Semax 10mg | Sample Type: White lyophilized powder | Lot Number: 112455 | MW (g/mol): 813.9 |
|------------------------------|-----------------------------------|---|------------------------------|-----------------------------|

ANALYTICAL METHODS

Identity: Confirmed via MALDI-MS



Purity: RP-HPLC (214 nm)

Content: HPLC quantitation

TEST RESULTS

| Specification | Result | Method | Status |
|-----------------|----------|-------------------|------------|
| Identity: Semax | Semax | MALDI-MS | ✓ Conforms |
| Content | 10.13 mg | HPLC Quantitation | ✓ Conforms |
| Overall Purity | 99.9% | RP-HPLC (214 nm) | ✓ Conforms |

HPLC Chromatogram (Retention Time: 8.419 min)

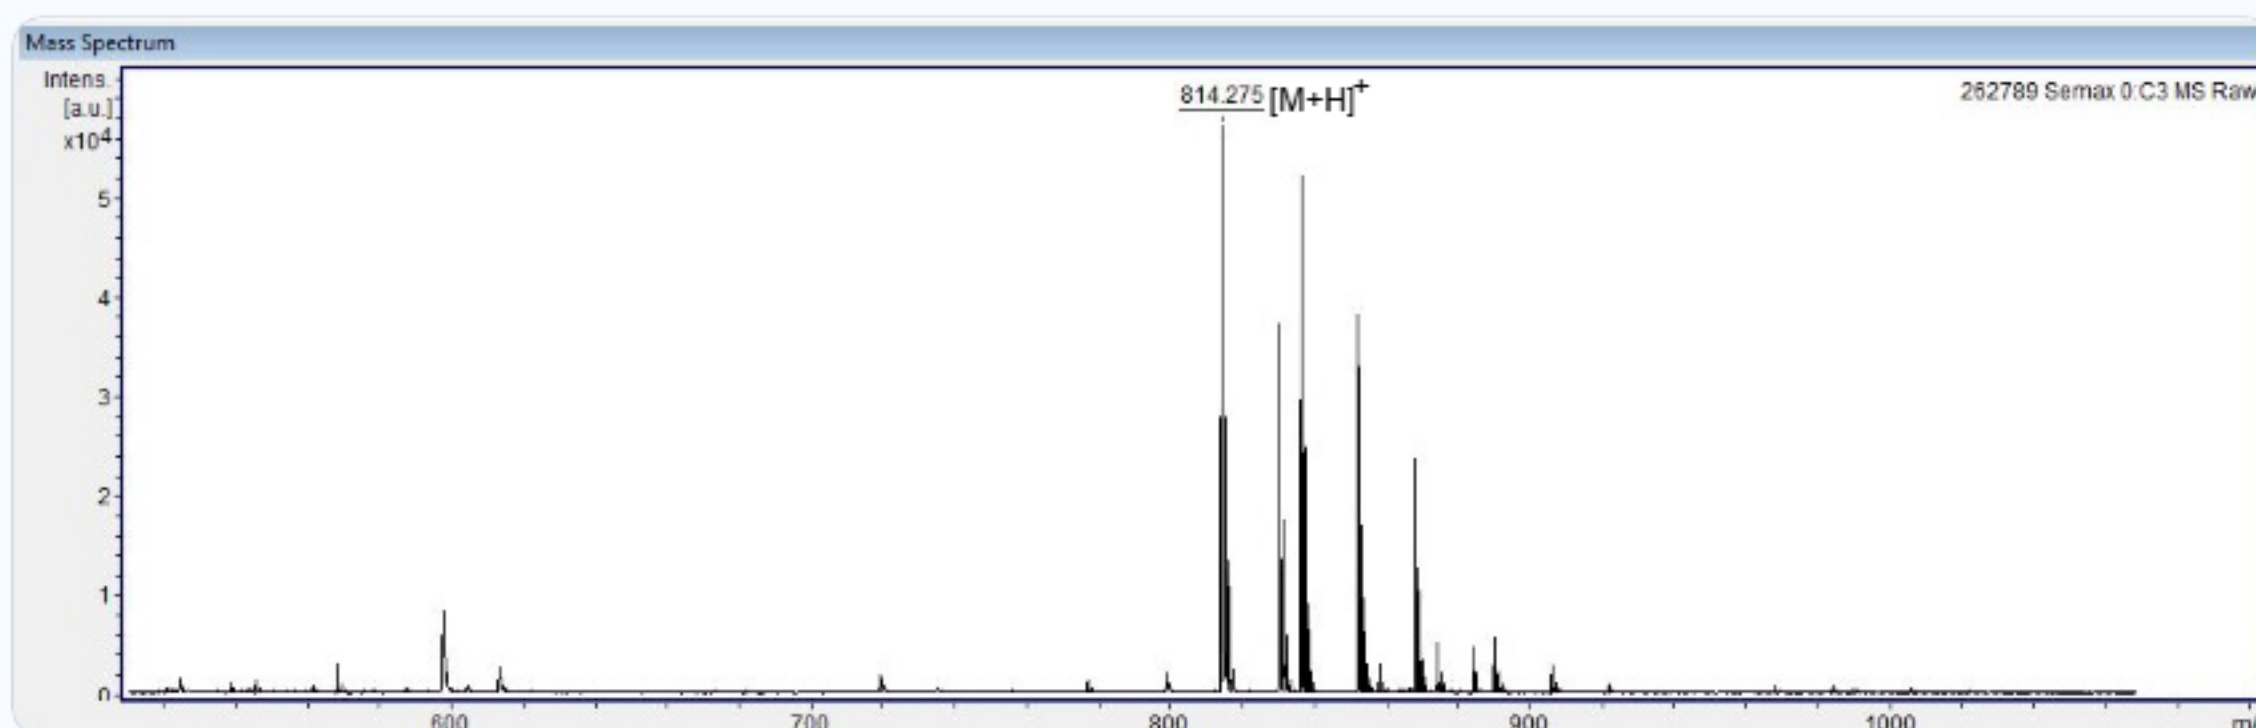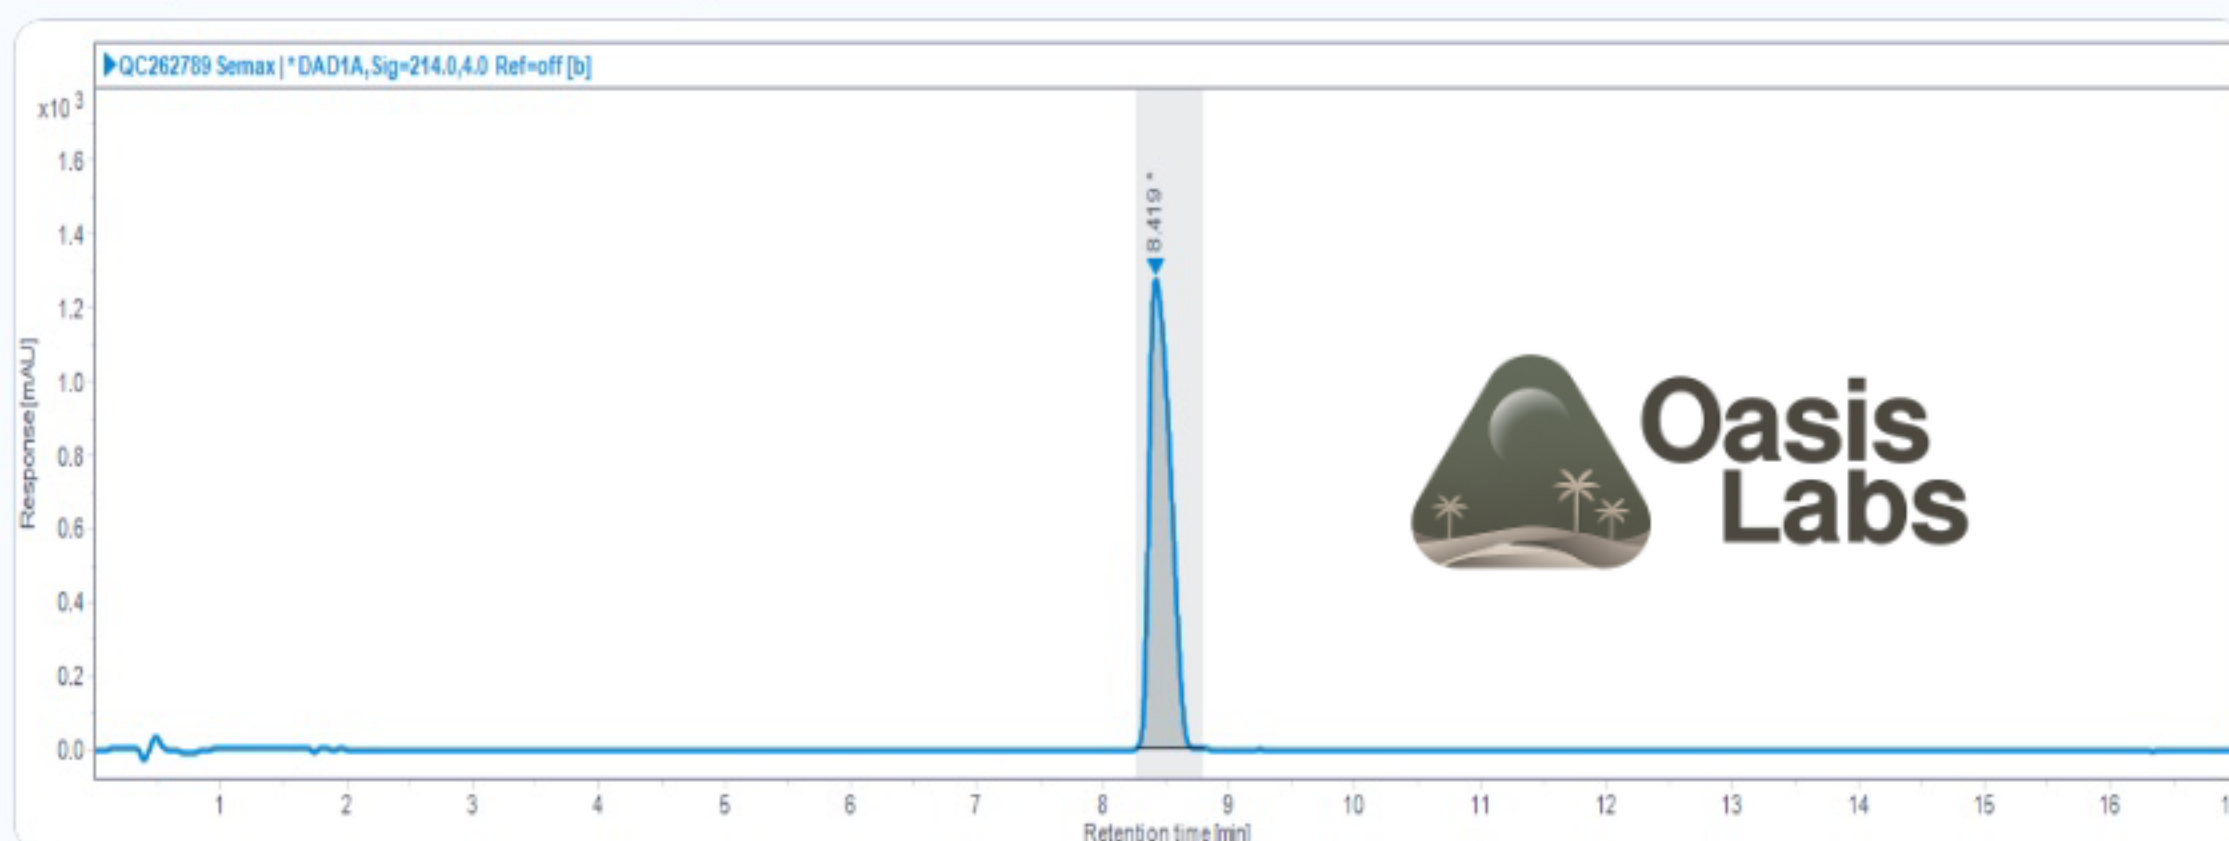

Certification: This COA confirms that the tested material meets or exceeds Bioviridian's analytical quality specifications for peptide research use.

Visit: <https://bioviridians.com/coa-search.html>



Shane Straight
 Shane Straight, M.S.
 Principal Chemist, Bioviridian Inc.